


Rescue Crook Low Voltage

KEY FEATURES & BENEFITS:

- Insulated crook for low voltage rescue
- Nylon construction
- Type tested to 15kV
- Designed for easy rescue

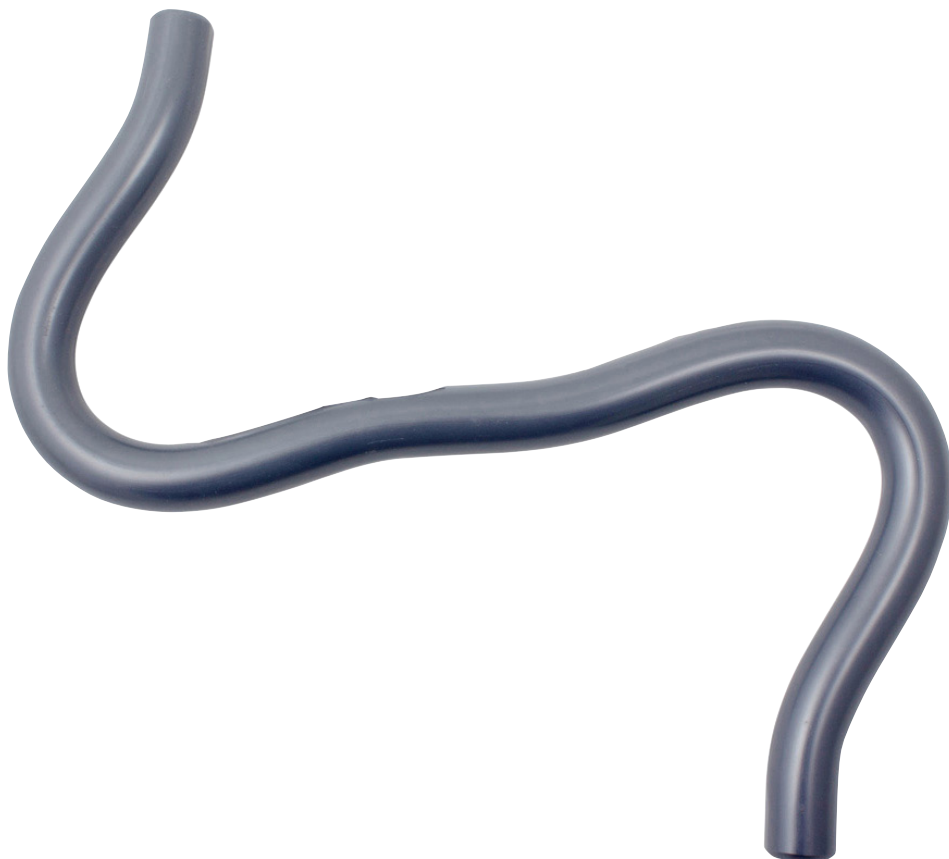

Part No.	Description
01015-LV-RH	Rescue Crook Low Voltage

No Australian Standard specifically covers rescue kits. Refer to your State Electrical or Safety Government department guidelines and local electricity authority's procedure for LV rescue procedures.

Any State Electrical or Safety Government department LV Rescue procedure will always precede this LV Rescue Kit contents and standards.

NOTE: the gloves provided have a test validity date of 6 months from the test date. We recommend regular 6-monthly voltage testing of this product. Testing can be carried out by our Legend technical laboratory. Refer to your State Electrical or Safety Government department to check your local legislation regarding testing.

In support of our policy of continuous product improvement we reserve the right to change materials and specifications without notice. Drawings, where used, are not to scale. All dimensions are in millimetres and sizes given are approximate. Where possible, technical MSDS data sheets are made available on the website. All products should be installed and used in accordance with manufacturer's instructions provided. Warning: products may be the subject of registered designs and patents. Refer to website for terms and conditions on warranty.